



## **Mitigation Method of Thermal Transient Stress by Thermalhydraulic-Structure Total Analysis**

Naoto KASAHARA<sup>1)</sup>, Masakazu JINBO<sup>2)</sup> and Hiromi HOSOGAI<sup>3)</sup>

1) Oarai Engineering Center, Japan Nuclear Cycle Development Institute(JNC), Japan

2) Toshiba Corporation, Japan

3) Joyo Industries Limited, Japan

### **ABSTRACT**

This study proposes a rational evaluation and mitigation method of thermal transient loads in fast reactor components by utilizing relationships among plant system parameters and stresses induced by thermal transients of plants. A thermalhydraulic–structure total analysis procedure helps us to grasp relationship among system parameters and thermal stresses. Furthermore, it enables mitigation of thermal transient loads by adjusting system parameters. In order to overcome huge computations, a thermalhydraulic–structure total analysis code and the Design of Experiments methodology are utilized. The efficiency of the proposed mitigation method is validated through thermal stress evaluation of an intermediate heat exchanger in Japanese demonstration fast reactor.

**KEY WORDS:** thermal stress, thermal transient, fluid, structure, total analysis, mitigation, fast reactor, component design, Design of Experiments, Object Oriented

### **INTRODUCTION**

Thermal transient stress induced by fluid temperature variation is the main loads in liquid metal fast breeder reactors (LMFBRs). Since LMFBRs have high temperature operative conditions and utilize low heat capacity metals for cooling fluid, its fluid temperature change rapidly according to plant operations. Fluid temperature variations cause thermal stresses with their high thermal conductivities.

Fig.1 is a plant system of Japanese demonstration fast breeder reactor (DFBR) [1], which has primary and secondary sodium circuits with water-steam lines. Power variations of core change their temperatures, and those predictions are required to evaluate thermal transient stresses. Here there are many system parameters of plants, which affect thermal transient conditions as in Fig.1. For considering scatter of these parameters, conservative thermal transient loads were assumed for structural design.

Thermal stresses become sometimes so critical in structural design that their rational prediction is highly expected. Precise evaluation, furthermore, leads to mitigations of thermal loads.

This study proposes the rational evaluation and mitigation method of thermal transient stress to realize optimum structural design of LMFBRs against thermal loads.

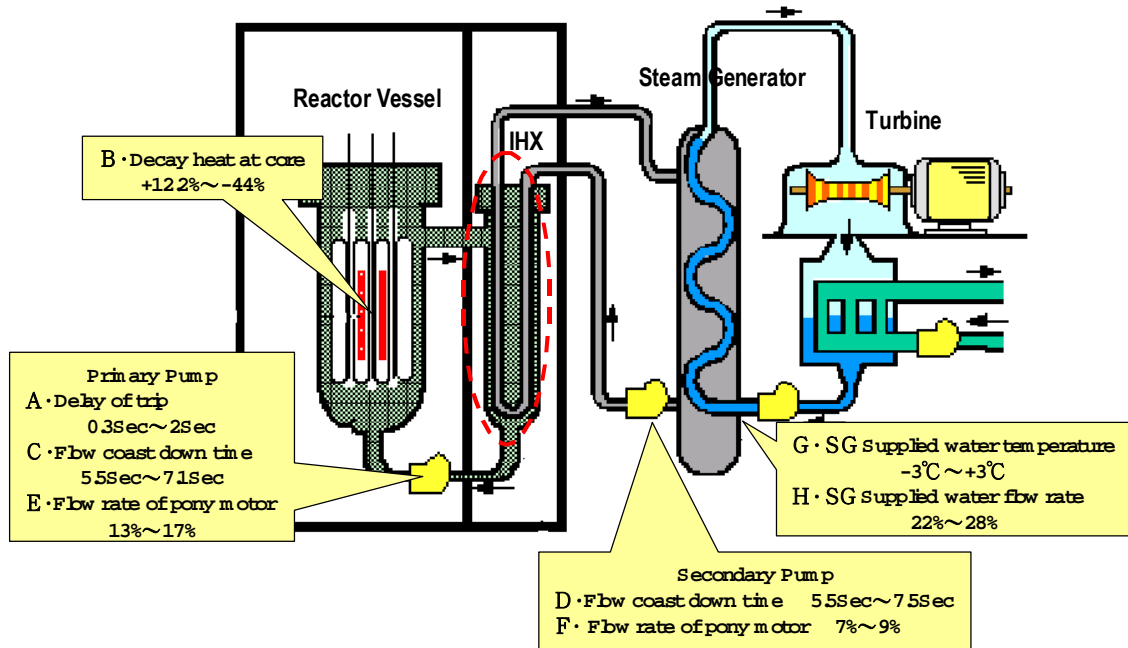


Fig.1 Example of system parameters of fast reactor plant which affect thermal transient loads

## CONVENTIONAL EVALUATION METHOD OF THERMAL TRANSIENTS

Conventional design procedure against thermal transient loads has two independent steps (Fig.2): (1) thermohydraulic analysis to determine thermal transient conditions and (2) structural analysis to check structural integrity under above conditions. In the first step, there are some difficulties for considering variation of system parameters. There are several parameters and their combination numbers are huge. Furthermore, it is difficult to anticipate an effect of each parameter on thermal stress because their relations are indirect. Therefore, many thermohydraulic analyses are performed to grasp scatter of fluid temperature from variation of related parameters. For structural analyses of the next step, thermal transient conditions are settled. Here qualitative relationships between fluid temperature and thermal stress are unclear. To consider unclarity of relation with stress and scatter of fluid temperature, design factors are introduced to make conservative thermal transient conditions. Once these conditions are determined, structural design efforts are taken under these given conditions.

Fig.3 is an example of evaluated thermal transient conditions at an intermediate heat exchanger (IHX) of Japanese DFBR when plant makes a trip. This figure compares the design thermal transient condition evaluated by the conventional method and the nominal condition obtained from thermal hydraulic analysis. As explained in Fig.1, this plant has eight system parameters from A to H, which have effective influences on thermal transients. For considering scatter from these parameters and unclear relationship with thermal stresses, conservative thermal transient conditions were settled, which gave 462MPa at the maximum stress portion. There remains possibility of over conservatism in this value.

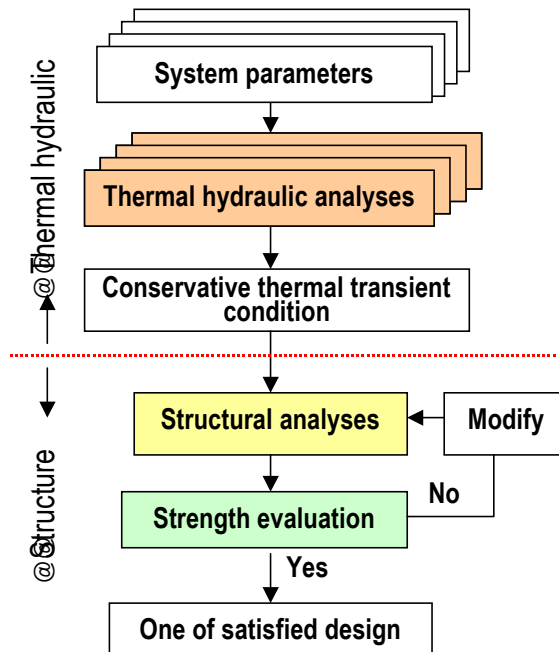


Fig.2 Conventional procedure by thermalhydraulic and structure independent analysis

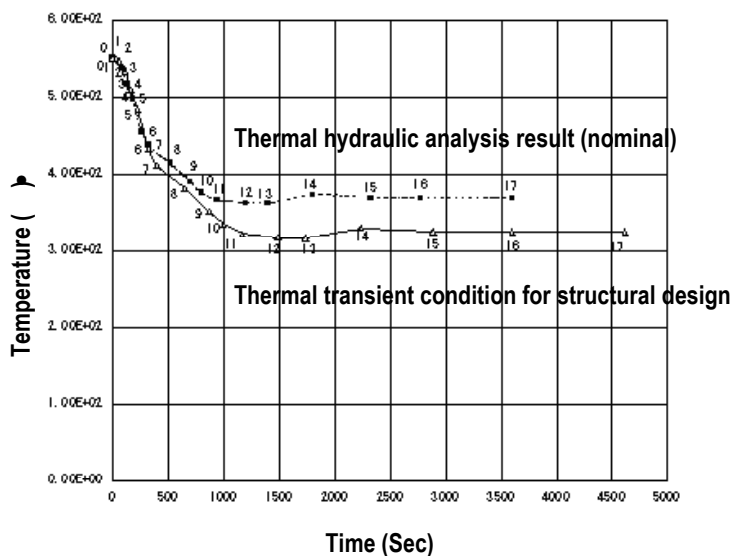


Fig.3 Thermal transient conditions at IHX evaluated by conventional method

### NEW EVALUATION METHOD OF THERMAL TRANSIENTS

This study proposes a new evaluation procedure of thermal transients by thermalhydraulic – structure total analysis. The procedure of Fig.4 can grasp relationship among system parameters, fluid temperature and thermal stresses, because both thermalhydraulic and stress analysis are performed for each combinations of system parameters. It avoids design margins for considering uncleanness among them. Therefore this procedure can evaluate thermal loads precisely and rationally compared with a conventional one. Furthermore, clear understanding between system parameters and thermal stress enables stress mitigation design by adjusting system parameters.

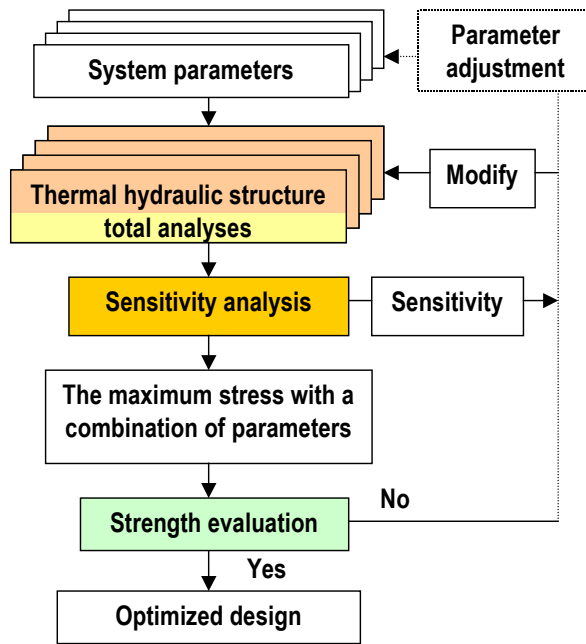


Fig.4 New procedure by thermalhydraulic-structure total analysis

The difficulty to realize above procedure is its huge computations. To overcome this problem, authors adopted two ideas. One is a utilization of an integrated analysis code named PARTS (Program for Arbitrary Real Time Simulation) for the simulation of both thermal-mechanical behaviors of structures and plant thermalhydraulic dynamics [2]. This code can analyze both fluid and structural behaviors by linkage of autonomous calculation parts based on object-oriented programs. Calculation time of thermal stress is less than 1/100 of conventional procedures by using Green's function method. Visual handling of calculation parts was also realized, and it leads to rapid data input. Fig.5 shows graphical user interface of PARTS code. In addition, the reliability of the program was improved by encapsulation. This code can omit data conversion process from a thermal hydraulic code to a structural analysis code and accelerate a turn-around time of calculation.

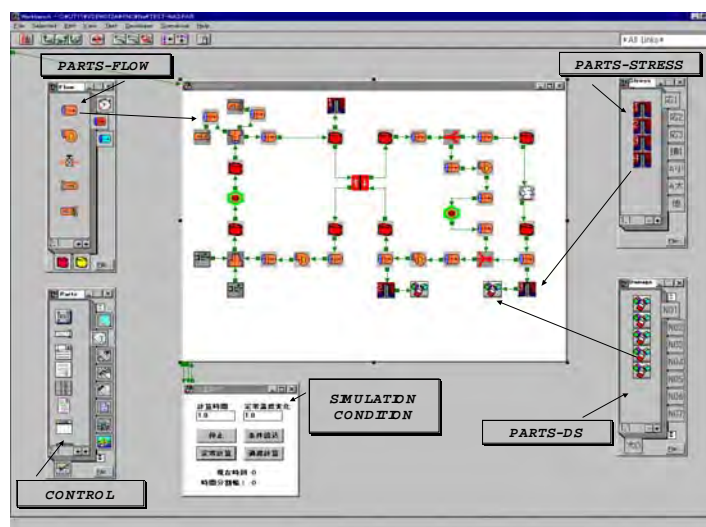


Fig.5 User interface of thermalhydraulic-structure total analysis code PARTS

Another device to overcome computations is the Design of Experiments ([3] for example). It reduces analysis cases that are required to evaluate many combinations of system parameters. For example, the DFBR has 8 system parameters and each parameter have the minimum, nominal and the maximum values as in Table 1. A total combination number of these parameters becomes 4374, however, the Design of Experiments reduces this number to 18 (Table 2) by taking orthogonal groups of a linear system into account [3].

Table 1 System parameters of Japanese DFBR which affect thermal transients at IHX

System parameters	Level of parameter		
	1, min	2, nom	3, max
a, Delay of primary pump trip		0.3 s	0.5 s
b, Decay heat at core	44 %	nom	62 %
c, Primary pump coast down time	5.5Sec	6.5Sec	7.1Sec
d, Secondary pump coast down time	5.5Sec	6.5Sec	7.5Sec
e, Primary pony motor flow rate	13 %	15 %	17 %
f, Secondary pony motor flow rate	1, V %	2, W %	3, X %
g, SG supplied water temperature	1, R °C	NOM	3, R °C
h, SG supplied water flow rate	22 %	25 %	28 %

Table 2 Orthogonal table of Design of Experiments methodology

Case No.	a, Delay of pump trip	b, Decay heat	c, Coast down time of Primary pump	d, Coast down time of secondary pump	e, Flow rate of primary pony motor	f, Flow rate of secondary pony motor	g, SG supplied water temperature	h, SG supplied water flow rate
1	1	1	1	1	1	1	1	1
2	1	1	2	2	2	2	2	2
3	1	1	3	3	3	3	3	3
4	1	2	1	1	2	2	3	3
5	1	2	2	2	3	3	1	1
6	1	2	3	3	1	1	2	2
7	1	3	1	2	1	3	2	3
8	1	3	2	3	2	1	3	1
9	1	3	3	1	3	2	1	2
10	2	1	1	3	3	2	2	1
11	2	1	2	1	1	3	3	2
12	2	1	3	2	2	1	1	3
13	2	2	1	2	3	1	3	2
14	2	2	2	3	1	2	1	3
15	2	2	3	1	2	3	2	1
16	2	3	1	3	2	3	1	2
17	2	3	2	1	3	1	2	3
18	2	3	3	2	1	2	3	1

## APPLICATION TO THE IHX OF JAPANESE DFBR

To validate efficiency of the proposed evaluation procedure, it was applied to thermal stress evaluation of the IHX in the Japanese DFBR. The Design of Experiments reduces analysis cases to grasp effects of system parameters to 18 analysis cases of Table 2. The PARTS code calculated fluid temperature and stress histories for these cases as in Fig.6 and Fig.7. Calculated results show that these results scatter according to variations of parameters. By using these results, the Design of Experiments methodology can predict the maximum and the minimum thermal stresses with combinations of parameters among all combinations (4374) like Table3. To confirm these predictions, parameters of Table 3 were input to PARTS code and were adopted to calculate temperature and stress. The severest cases in Fig.6 and Fig.7 are results that give the maximum stress and the moderate cases are ones which give the minimum stress. Lower colom of Table 3 compares the maximum and the minimum stresses between predictions from Design of Experiments methodology and calculations by the PARTS code. These results proved that the Design by Experiments can adequately predict the maximum and the minimum stresses.

Next, obtained thermal stresses by the new procedure are compared with conventional ones. The predicted maximum stress 420.9MPa was 9% lower than 462.0MPa calculated by the conventional method. Comparison between Fig.3 and Fig.6 can explain that reason. Thermal transient condition settled by the conventional method is over conservative compared with the severest case by the new procedure. It means that the proposed method can rationally evaluate thermal transient conditions and thermal stresses.

Furthermore, let us pay attention to the minimum thermal stress 298.1MPa that is 35% lower than the value by the conventional method. The best combination of system parameters in Table 3 gives this stress. Usually some parameters are uncontrollable, so that, it is difficult to achieve best parameters. Therefore, realistic approach to mitigate thermal stress is proposed here. The Design of Experiments methodology gives the sensitivities of thermal stress to each parameter as in Fig.7. By adjusting controllable and sensitive parameters, thermal loads can be mitigated.

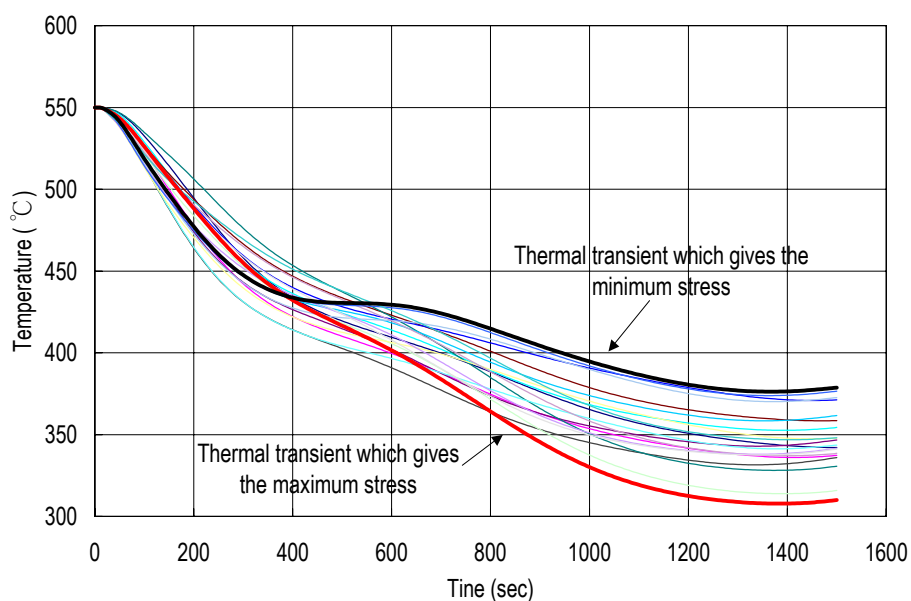


Fig.6 Fluid temperature calculated by PARTS code

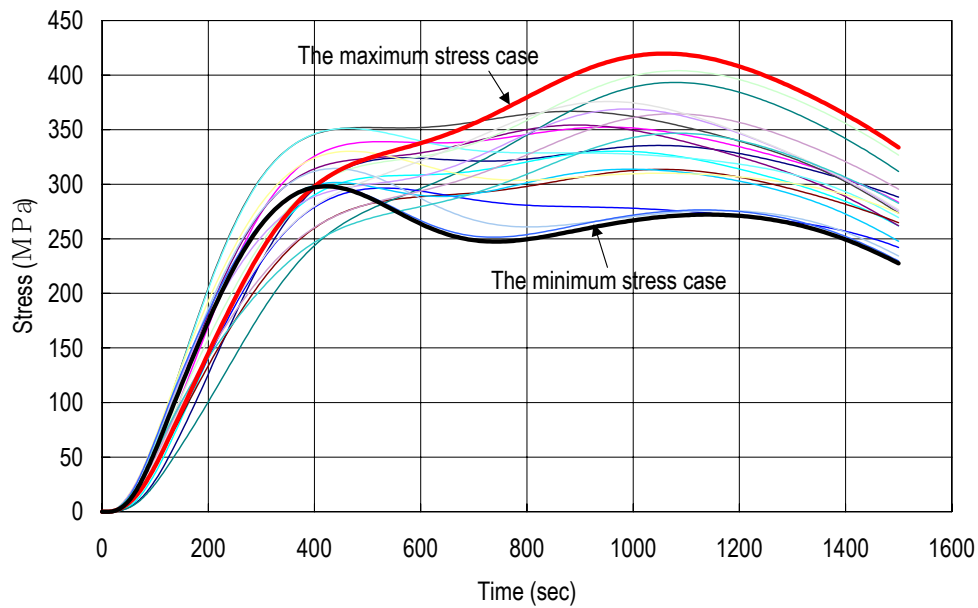


Fig.7 Thermal stress calculated by PARTS code

Table 3 Maximum and minimum stress with combination of parameters predicted from Design of Experiments methodology

	Min stress	Max stress
A · Delay of primary pump trip	MIN	NOM
B · Decay heat at core	MAX	MIN
C · Flow coast down time of primary pump	MAX	MIN
D · Flow coast down time of secondary pump	MIN	NOM
E · Flow rate of primary pony motor	MAX	MIN
F · Flow rate of secondary pony motor	MIN	MAX
G · SG supplied water temperature	MAX	NOM
H · SG supplied water flow rate	MIN	MAX
Prediction from design by experiment	277.8	420.9
Calculation by PARTS Code	298.1	413.6

Evaluation by conventional procedure	-	462.0
--------------------------------------	---	-------

(Unit MPa)

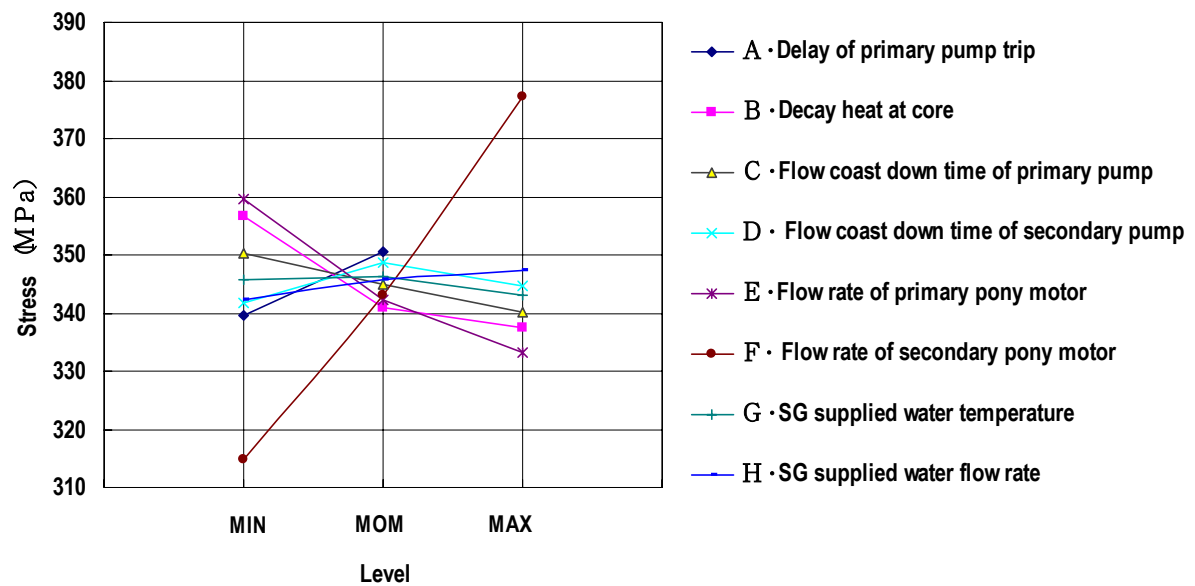


Fig.7 Sensitivities of thermal stress to system parameters evaluated from Design of Experiments methodology

## CONCLUSIONS

A thermalhydraulic – structure total analysis procedure can grasp relationship among system parameters and thermal stresses. It enables rational prediction of thermal loads, because it avoids conservative assumption of thermal transient conditions. Furthermore, adjustment of system parameters, to which thermal stress is sensitive, can mitigate thermal loads.

To validate efficiency of the proposed method, it was applied to thermal stress evaluation of an intermediate heat exchanger in a Japanese demonstration fast reactor. A predicted thermal stress was 9% lower than a value calculated by conventional method. Possibility of thermal loads mitigation by adjusting system parameters was 35%. These results show that a proposed method is quite effective to evaluate rationally and to mitigate thermal transient loads.

## ACKNOWLEDGEMENT

The authors are deeply indebted to Mr. Masaaki INOUE of Toshiba Corporation for his contributions to parametric analysis by PARTS code.

## REFERENCES

- [1] Nakamura, T et al., The development of demonstration fast breeder reactor (DFBR), IAEA, TECDOC-907, pp:59-70, (1995)
- [2] Naoto Kasahara and Masaaki Inoue, Object Oriented Design Procedure for Nuclear Components Against Thermal Transient Stress, ASME, PVP-Vol.360, Pressure Vessel and Piping Codes and Standards, (1998)
- [3] William Y. Fowlkes and Clyde M. Creveling, Engineering Methods for Robust Product Design: Using Taguchi Methods in Technology and Product Development, Prentice Hall PTR, (1995)